



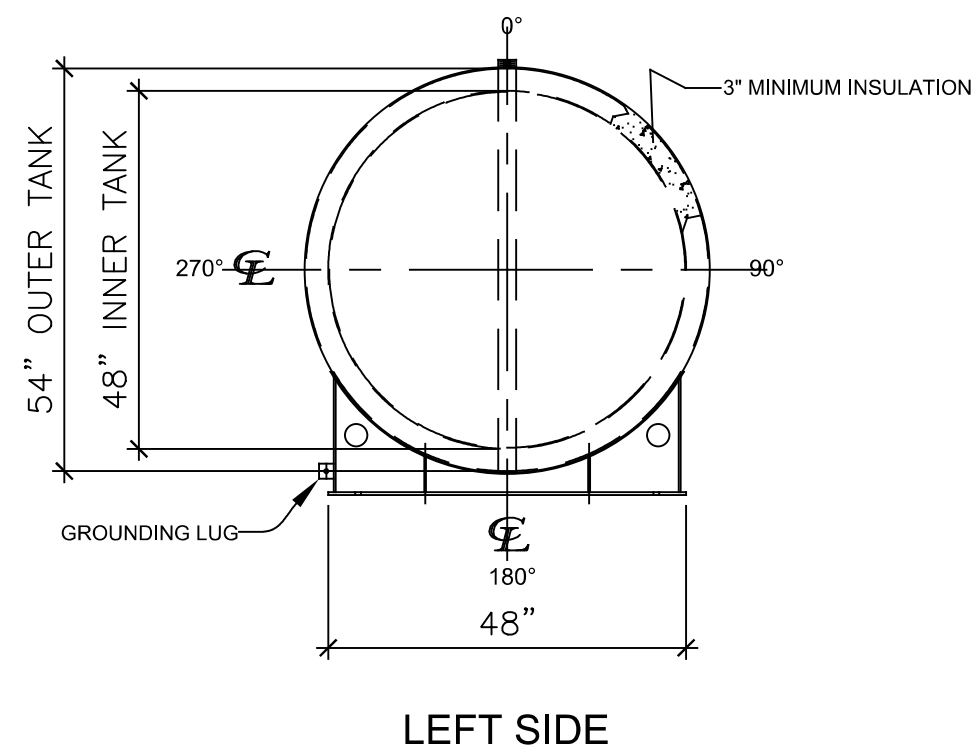

NOZZLE SCHEDULE								
ITEM	SIZE	RATING	TYPE	MATL	PROJ. IN	PROJ. OUT	REMARKS	NOTES
A	4"	N.P.T.	W.F.	C.S.	STD.	STD.	PRIMARY	EMERGENCY VENT OPENING
B	4"	N.P.T.	CPL.	C.S.	STD.	STD.	SECONDARY	EMERGENCY VENT OPENING
C	2"	N.P.T.	CPL.	C.S.	STD.	STD.	-	-
D	4"	N.P.T.	CPL.	C.S.	STD.	STD.	-	-
E	2"	N.P.T.	PIPE	C.S.	STD.	STD.	-	MONITORING PORT
F	4"	N.P.T.	CPL.	C.S.	STD.	STD.	-	INTERSTICE FILL

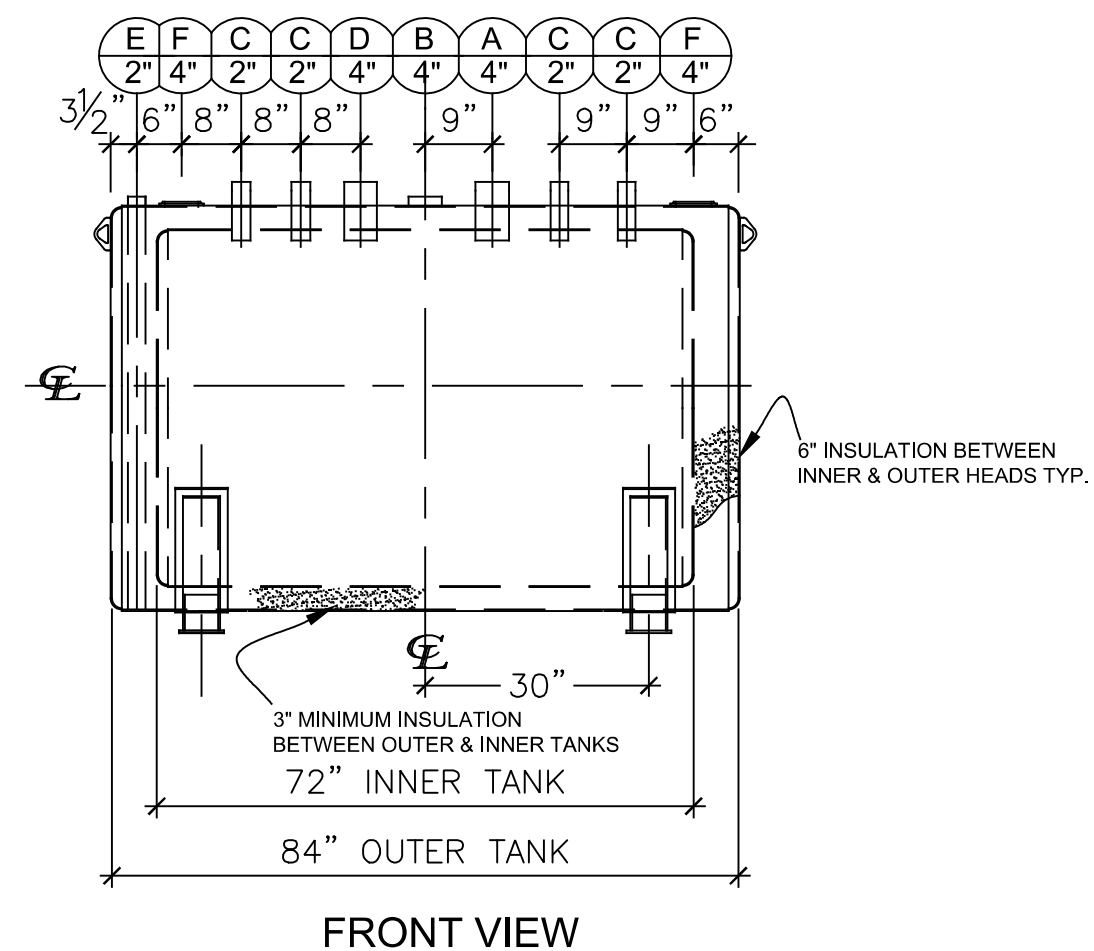

- NOTES:**
- A. Material: H.R. Carbon Steel.
 - B. Design Pressure: Atmospheric.
 - C. Design Temperature: Ambient.
 - D. Built & labeled per U.L. #142, #2085 & STI Fireguard Specifications.
 - E. Interstice to be filled w/ 3" min. thermal insulation per Fireguard specs.
 - F. Exterior: Blast & apply one shop coat WHITE enamel.
 - G. All fittings to be labeled and protected for shipment.
 - H. Customer to verify nozzle sizes, locations and quantities.
 - I. Saddles/skids may require shimming or grouting during installation.

APPROVAL FOR CONSTRUCTION SCHEDULE A - MASTER TERMS & CONDITION OF SALE* ☐ APPROVED AS DRAWN ☐ APPROVED WITH NOTED CHANGES. CONSTRUCTION WILL BE SCHEDULED WHEN SIGNED DRAWING AND CONFIRMED ORDER ARE RECEIVED. SIGNATURE: _____ DATE: _____		SALES ORDER:		WEIGHT (LBS): 3350	
		ONE CLARION www.clarionmunicipal.com		All units inches unless stated otherwise	
DESCRIPTION: 550 Gallon 48" I.D. x 6'-0" O.A.L. Fireguard Saddle Tank					
CUSTOMER:				P.O.#	
DATE: 3/8/2023	SCALE:	DWG.# NB00550FGD04810G	DRAWN BY: AJC SHEET 1 OF 1		